


PUMP TROUBLE ALARM FIELD INPUT DEFINITIONS	
PT 1	
PT 2	
PT 3	
PT 4	
PT 5	
PT 6	
PT 7	
PT 8	

AUX ALARM CONTACTS
PROGRAM ALARM FUNCTION
VIA HMI TOUCH SCREEN ON DOOR

FIELD ALARM RELAY DEFINITIONS	
AUX 1	
AUX 2	
AUX 3	
AUX 4	
AUX 5	
AUX 6	
AUX 7	
AUX 8	

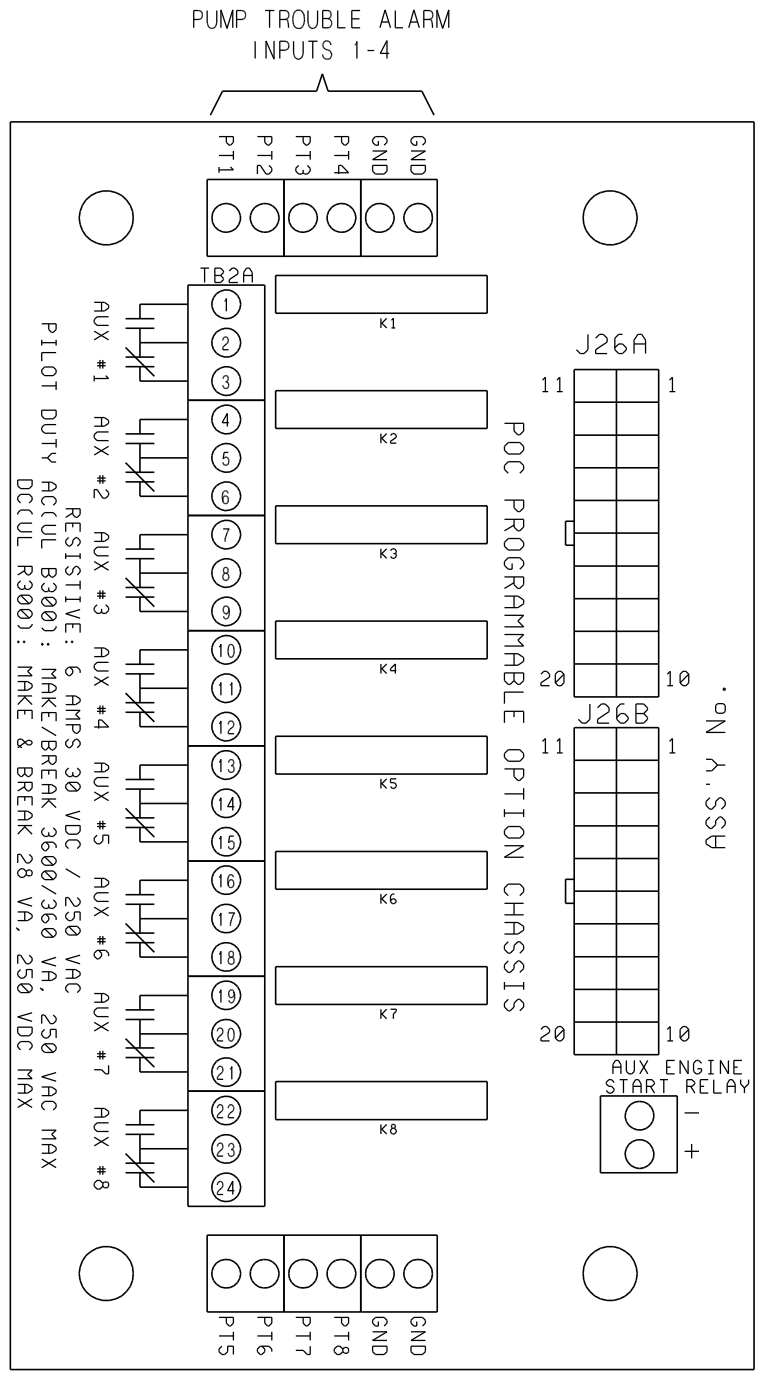

RESISTIVE: 6 AMPS 30 VDC / 250 VAC
 PILOT DUTY AC(CUL B300): MAKE/BREAK 3600/360 VA, 250 VAC MAX
 DC(CUL R300): MAKE & BREAK 28 VA, 250 VDC MAX

PUMP TROUBLE ALARM
INPUTS 5-8
(FOR TRANSFER SW CONTROLLER
PT8 INPUT CAN BE USED FOR REMOTE
TRANSFER TEST BUTTON IF ENABLED.
MOD 82H)