

NEMA Standards Publication ICS 14-2010

Application Guide for Electric Fire Pump Controllers

Published by:

National Electrical Manufacturers Association

1300 North 17th Street, Suite 1752

Rosslyn, Virginia 22209

www.nema.org

© Copyright 2010 by the National Electrical Manufacturers Association. All rights including translation into other languages, reserved under the Universal Copyright Convention, the Berne Convention for the Protection of Literary and Artistic Works, and the International and Pan American Copyright Conventions.

NOTICE AND DISCLAIMER

The information in this publication was considered technically sound by the consensus of persons engaged in the development and approval of the document at the time it was developed. Consensus does not necessarily mean that there is unanimous agreement among every person participating in the development of this document.

The National Electrical Manufacturers Association (NEMA) standards and guideline publications, of which the document contained herein is one, are developed through a voluntary consensus standards development process. This process brings together volunteers and/or seeks out the views of persons who have an interest in the topic covered by this publication. While NEMA administers the process and establishes rules to promote fairness in the development of consensus, it does not write the document and it does not independently test, evaluate, or verify the accuracy or completeness of any information or the soundness of any judgments contained in its standards and guideline publications.

NEMA disclaims liability for any personal injury, property, or other damages of any nature whatsoever, whether special, indirect, consequential, or compensatory, directly or indirectly resulting from the publication, use of, application, or reliance on this document. NEMA disclaims and makes no guaranty or warranty, express or implied, as to the accuracy or completeness of any information published herein, and disclaims and makes no warranty that the information in this document will fulfill any of your particular purposes or needs. NEMA does not undertake to guarantee the performance of any individual manufacturer or seller's products or services by virtue of this standard or guide.

In publishing and making this document available, NEMA is not undertaking to render professional or other services for or on behalf of any person or entity, nor is NEMA undertaking to perform any duty owed by any person or entity to someone else. Anyone using this document should rely on his or her own independent judgment or, as appropriate, seek the advice of a competent professional in determining the exercise of reasonable care in any given circumstances. Information and other standards on the topic covered by this publication may be available from other sources, which the user may wish to consult for additional views or information not covered by this publication.

NEMA has no power, nor does it undertake to police or enforce compliance with the contents of this document. NEMA does not certify, test, or inspect products, designs, or installations for safety or health purposes. Any certification or other statement of compliance with any health or safety-related information in this document shall not be attributable to NEMA and is solely the responsibility of the certifier or maker of the statement.

CONTENTS

Foreword.....	ii
1 GENERAL	1
1.1 Scope.....	1
1.2 Referenced Publications	1
1.3 Special Considerations for Fire Pump Controllers	1
2 DESIGN CONSIDERATIONS	2
2.1 Power Conductors Connected to the Fire Pump Controller and Motor.....	2
2.2 Environmental Considerations for Enclosures	4
2.3 Transformer Sizing.....	7
2.4 Transfer Switch Considerations	8
2.5 Considerations for Specifying Short Circuit Rating (RMS SYM)	11
2.6 Reduced Voltage Starting Methods	15
2.7 Limited Service Controller Limitations.....	15
2.8 Listed Fire Pump Motor Applications	16
2.9 Pressure Recorders	17
2.10 Stand-By Generator Sizing for Fire Pumps.....	17
2.11 Medium Voltage Fire Pump Controllers (7.2 kV Max)	18
2.12 Variable Speed Pressure Limiting Electric Fire Pump Controllers.....	19
2.13 Upstream Overcurrent Protection for Fire Pump Circuits.....	21
3 INSTALLATION CONSIDERATIONS	21
3.1 Phase Sequence.....	21
3.2 Normal Starting with On-Site Generators	22
3.3 Induced Voltages on Contacts For Remote Signaling	22
3.4 Grounded Circuit Conductor (Neutral or Neutral Conductor) Considerations.....	22
4 OTHER CONSIDERATIONS.....	23
4.1 Listed and Approved Equipment.....	23
4.2 Testing and Maintenance.....	23
Tables	
1 Comparison of Specific Applications of Enclosures for Indoor Non-hazardous Locations	6
2 Fire Pump Controller Short Circuit Current Rating	12
3 Transformer Secondary Voltage and Available Secondary Short-Circuit Current	14
4 Reduced Voltage Starting Methods	15
Figures	
1 Typical Fire Pump Controller and Transfer Switch Arrangements I and II Normal Source from a Utility and Alternate Source from an On-Site Generator	9
3 Variable Speed Pressure Limiting Electric Fire Pump Controller	20

Foreword

This Application Guide was prepared by a technical committee of the National Electric Manufacturers Association (NEMA) Industrial Control and Systems Section. It was approved in accordance with the bylaws of NEMA.

This Application Guide provides practical information concerning the general technical considerations in the installation of electric fire pump controllers. It is intended to be used by specifiers, purchasers, installers, and owners of fire pump controllers.

This Application Guide represents the result of many years of research, investigation, and experience by the members of the NEMA Industrial Control and Systems Subcommittee on Fire Pump Control. It was written as a service in response to the many questions from the user public, specifiers, and inspection authorities regarding fire pump controller installations. The intent is to pursue excellence in design, manufacture, and service of products made by NEMA member companies. It has been developed through continuing consultation among manufacturers, users, and national engineering societies. It is not intended to instruct the user on use of fire pump control equipment except to provide recommendations and some application guidance.

This Application Guide is necessarily confined to providing recommendations for a successful installation. When equipment conforming with these recommendations is properly selected, is installed in accordance with the *National Electrical Code* (NFPA 70) and the *Standard for the Installation of Stationary Pumps for Fire Protection* (NFPA 20), and is properly maintained, the hazards to persons and property will be reduced. However, since any piece of industrial control equipment can be installed, operated, and maintained in such a manner that hazardous conditions may result, following the recommendation of this Guide does not by itself assure a safe installation.

NEMA publications are subject to periodic review. They are revised frequently to reflect user input and to meet changing conditions and technical progress. Users should secure the latest editions.

Proposed revisions to this Application Guide should be submitted to:

Vice President, Technical Services
National Electrical Manufacturers Association
1300 North 17th Street, Suite 1752
Rosslyn, Virginia 22209

1 GENERAL

1.1 SCOPE

This Application Guide is intended to provide general guidelines for the proper application of fire pump controllers. The emphasis of these guidelines is to stress those considerations specific to fire pump installations. Applicable NEMA standards and the standards of other standards developing organizations should also be consulted.

1.2 REFERENCED PUBLICATIONS

IEEE 242-2001	<i>IEEE Recommended Practice for Protection and Coordination of Industrial and Commercial Power Systems</i>
NEMA 250 2008	<i>Enclosures for Electrical Equipment (1000 Volts Maximum)</i>
NEMA ICS 3-1993 (R2000)	<i>Industrial Control and Systems: Medium Voltage Controllers Rated 2001 to 7200 Volts AC</i>
NEMA ICS 3.1-1997	<i>Industrial Control and Systems. Handling, Storage and Installation Guide for AC General Purpose contactors and class E Controllers, 50 & 60 Hz</i>
NEMA ICS 15-2004	<i>Instructions for the Handling, Installation, Operation and Maintenance of Electric Fire Pump Controllers Rated Not More Than 600V</i>
NFPA 20-2010	<i>Standard for the Installation of Stationary Pumps for Fire Protection¹</i>
NFPA 25-2008	<i>Standard for the Inspection, Testing, and Maintenance of Water-Based Fire Protection Systems</i>
NFPA 70-2008	<i>National Electrical Code²</i>

1.3 SPECIAL CONSIDERATIONS FOR FIRE PUMP CONTROLLERS

Installation requirements of fire pump controllers by virtue of their special considerations, are covered in Article 695 of the National Electrical Code (NFPA 70) and the performance, maintenance, and acceptance testing of the fire pump system and the internal wiring of the components of the system are covered in NFPA 20. Periodic testing of the complete fire protection system is addressed in NFPA 25. These requirements in many significant ways, are uniquely different from those pertaining to industrial, commercial and residential installations in order to increase the reliability of the system. As an overview, some of these differences are:

- a) Service Disconnects:
Special rules pertaining to the service disconnects in order to minimize inadvertent disconnection (NFPA 70, 695.3 which refers to 230.82(5), 230.2, and 230.72(B)). Only one upstream disconnect and associated over current protective device is permitted (NFPA 70 695.4).
- b) Conductor Protection:
 1. Special overcurrent and physical protection requirements for the power supply conductors exist to minimize potential interruption during a fire (NFPA 70, 695.3(A), 695.4(B)(1), and 695.5(C)(2)).
 2. Coordinated overcurrent protection of the motor branch circuit conductors to trip the circuit breaker in the fire pump controller rather than an upstream device (NFPA 70, 240.12).

¹ Particular attention should be given to Chapters 9 and 10.

² Particular attention should be given to Article 695.

c) No Motor Overload Protection:

Fire pump motor protection is limited to locked rotor and short circuit protection only (NFPA 20, 10.4.3 and 10.4.4).

d) Critical Components:

Certain conductors and electrical components are not protected from overcurrent in the interest of getting a distressed pump going (NFPA 20, 10.4.3, 10.4.4, and 10.4.5; NFPA 70, 695.6(C&D)).

e) No Ground Fault Protection:

Ground fault protection is prohibited (NFPA 70, 695.6, 240.13).

f) Control Circuits:

1. External control circuits that extend outside the fire pump room shall be arranged so that failure of any external circuit (open or short-circuit) shall not prevent operation of pump(s) from all other internal or external means (NFPA 20, 10.5.2.6; NFPA 70, 695.14).
2. Failure of external control circuits may cause a motor run condition (NFPA 20, 10.5.2.6.2; NFPA 70, 695.14).
3. Overcurrent protection in necessary control circuits is prohibited (NFPA 20, 10.3.5).

g) Fire Pump Controller Circuit Breaker Settings:

1. The trip setting of the fire pump controller circuit breaker can be up to 20 times motor full load current (NFPA 20, 10.4.3.3.1(6)).
2. The fire pump controller circuit breaker shall have a continuous rating of not less than 115 percent of full-load current and shall not trip when carrying up to 300 percent of motor full-load current (NFPA 20, 10.4.3.3.1(1), 10.4.4(1)(b)).
3. The fire pump controller circuit breaker shall trip between 8 and 20 seconds at motor locked-rotor current (NFPA 20, 10.4.4(1)(a)).

h) Remote Control Stations:

Remote control stations shall not be capable of stopping the fire pump (NFPA 20, 10.5.2.4).

i) Supplying Other Equipment: Fire pump controllers may not be used as a junction box to supply other equipment (including jockey pumps) (NFPA 20, 10.3.4.6 NFPA 70, 695.6(F)).

j) Automatic Non-pressure Switch-actuated Starting:

A non-pressure switch-actuated automatic fire pump controller shall commence its starting sequence by the automatic opening of a remote contact (NFPA 20, 10.5.2.2 or 10.5.2.2.1).

Note: See 2.12 for significant deviations for medium voltage fire pump controllers and refer to NEC Article 490.

2 DESIGN CONSIDERATIONS

2.1 POWER CONDUCTORS CONNECTED TO THE FIRE PUMP CONTROLLER AND MOTOR

2.1.1 This is a suggested procedure for properly sizing power supply conductors to the fire pump controller and motor to meet the requirements of NFPA 20 and NFPA 70:

- a) Determine the motor full-load current from the motor nameplate or NFPA 70, Table 430.250
- b) Multiply the full-load current by 1.25 per NFPA 70 695.6C(1).
- c) Select supply conductor size per NFPA 70 310.15 and Table 310.16, based upon current calculated in step b above. Use 75°C column as appropriate (see NFPA 70 110.14(C)).

For conductors from the controller to wye-delta and part winding motors where six leads are required, sizing should be as follows:

1. Part winding - Each conductor carries 50 percent of the motor full-load current (see NFPA 70 430.22(D)).
2. Wye-Delta - Each conductor carries 58 percent of the motor full-load current (see NFPA 70 430.22(C)).

Parallel conductors may be required for large motors. See NFPA 70 310.4, and refer to controller manufacturers' field connection instructions for conductor termination information.

- d) Verify that the conductor size will provide compliance with the voltage drop limitations as outlined in NFPA 20 9.4 or NFPA 70 695.7.

Note: NFPA 70 **does not** require conductors to be sized to carry a minimum of 300 percent of motor full-load current nor locked-rotor current indefinitely. See NFPA 695.6(C)(1) and 695.6(C)(2).

- e) Consult motor manufacturers connection diagram for proper connections to the controller.

Example: 300 Hp, 460 Volt, 60 hertz controller is located 500 feet from the utility supply and the motor is 25 feet from the controller. Example is based on the use of copper conductors. Refer to controller manufacturers field connection instructions for use of aluminum conductors.

- a) Motor full-load current is 361 amperes.
- b) $361 \times 1.25 = 451$ amperes.
- c) 700 kcmil, 75°C, is rated for 460 amperes for three conductors in one conduit. For two conductors per phase, 2-4/0, 75°C, in two separate conduits is also rated for 460 amperes. For two conductors per phase, 2-300 kcmil, 75°C, in one conduit is rated for 456 amperes. See NFPA 70 Table 310.15(B)(2)(a).

Note: Had the ambient temperature been 40°C in the above examples the conductor sizes would have been 900 kcmil, 2-300 kcmil, and 2-400 kcmil respectively. See correction factors of NFPA 70, Table 310.16.

- d) Maximum allowable voltage drop:
 - 1) Method of calculating the motor running voltage drop for 700 kcmil copper conductor in 525 ft of steel conduit.

Note: Total voltage drop to the controller should not exceed 5 percent ($5 \text{ percent} \times 460 = 23$ volts (line-to-line)).

- a) See NFPA 70, Chapter 9, Table 9, effective Z at 85 percent power factor for uncoated copper wire which equals 0.047 ohms/1000 ft.

Note: The value for 600 kcmil is used since the table does not list a value for 700 kcmil.

- b) Divide 0.047 ohms/1000 ft by 1000 and multiply the result by 525 ft which equals 0.0247 ohms.
- c) Multiply motor full-load amperes 361 by 1.15 which equals 415 amperes (refer to NFPA 70 695.7 or NFPA 20 9.4.3).
- d) Multiply 415 amperes by 0.0247 ohms, which equals 10.2 volts.
- e) Multiply 10.2 times 1.732, which equals 17.7 volts (line-to-line).
 - 1) This equals 3.8 percent which is less than the 5 percent permitted. Using only effective Z provides a simplified estimate of voltage drop.

- 2) Method of calculating the motor starting voltage drop for 700 kcmil copper conductor in 500 ft of steel conduit.

Note: Total voltage drop to the controller should not exceed 15% ($15\% \times 480 = 72$ volts (line-to-line)).

- a) See NFPA 70, Chapter 9, Table 9, effective Z at 30% power for uncoated copper wire which equals 0.053 ohms/1000 ft.

Note 1: The value for 600 kcmil is used since the table does not list a value for 700 kcmil.

Note 2: The effective Z at 30 percent power factor is calculated in accordance with Note 2 of Table 9.

- b) Divide 0.053 ohms/1000 ft by 1000 and multiply the result by 500 ft which equals 0.0265 ohms.
- c) Multiply motor full-load amperes 361 by 6, which equals 2,166 amperes (the locked rotor current of a NEMA Design B 3-phase squirrel cage induction motor is approximately six times the full load current of that motor, and this approximation is used throughout similar examples in this Guide. For more precise calculations, use the actual motor data plate locked rotor current. *Maximum* locked rotor currents are provided in NFPA 20 Table 9.5.1.1).
- d) Multiply 2,166 amperes by 0.0265 ohms, which equals 57.4 volts.
- e) Multiply 57.4 times 1.732 which equals 99.4 volts (line-to-line).

This equals 20.7 percent which is not less than the 15 percent permitted. Use the next largest conductor size and recalculate. Using only effective Z provides a simplified estimate of voltage drop.

Note: Confirmation of voltage drop under motor starting conditions typically cannot be accomplished with a standard voltmeter. Special instrumentation is normally required.

2.1.2 FIRE RATED CABLE FOR INCOMING POWER CONDUCTORS

Needs renumbering

2.1.2.1 Where single conductors are used (individual conductors), NFPA 20 9.8 requires that they be provided as part of a Listed Electrical Circuit Protective System. Installation of single conductors shall be according to the following procedure.

- a) They shall be terminated in a separate junction box and not enter the fire pump enclosure separately.
- b) The raceway between a junction box and the fire pump controller shall be sealed at the junction box end with an identified compound and in accordance with the instructions of the electrical circuit protective systems if provided.
- c) The junction box shall meet the following criteria:
 - 1) It shall be securely mounted.
 - 2) If mounted to the fire pump controller, its installation shall not violate the enclosure type rating of the fire pump controller.
 - 3) If mounted to the fire pump controller, its installation shall not violate the mechanical integrity of the fire pump controller and shall not affect the short circuit rating of the controller (contact FPC manufacturer for more details).
 - 4) As a minimum, a Type 2, drip-proof enclosure shall be used. The enclosure shall be listed to match the fire pump controller enclosure type rating.
- d) Standard wiring between the junction box and the controller is acceptable.

2.1.3 Special attention should be given to the termination of approved wiring systems to the controller when applied with the recommendations of the manufacturer and the listing agency. In addition, attention should be given to the use of listed wire connectors at the motor.

2.2 ENVIRONMENTAL CONSIDERATIONS FOR ENCLOSURES

2.2.1 NFPA 20 10.3.3.1 requires the minimum enclosure rating to be a Type 2 (see NEMA Standards Publication 250, *Enclosures for Electrical Equipment (1000 Volts Maximum)*, for further details).

2.2.2 Where the equipment is located outside or where special environments exist, suitably rated enclosures are required. The specific enclosure types, their applications, and the environmental conditions they are designed to provide a degree of protection against are as follows:

- 1) Type 2: Enclosures constructed for indoor use to provide a degree of protection to personnel against access to hazardous parts; to provide a degree of protection of the equipment inside

the enclosure against ingress of solid foreign objects (falling dirt); and to provide a degree of protection with respect to harmful effects on the equipment due to the ingress of water (dripping and light splashing).

2) Type 3R: Enclosures constructed for either indoor or outdoor use to provide a degree of protection to personnel against access to hazardous parts; to provide a degree of protection of the equipment inside the enclosure against ingress of solid foreign objects (falling dirt); to provide a degree of protection with respect to harmful effects on the equipment due to the ingress of water (rain, sleet, snow); and that will be undamaged by the external formation of ice on the enclosure.

Type 3RX: Enclosures constructed for either indoor or outdoor use to provide a degree of protection to personnel against access to hazardous parts; to provide a degree of protection of the equipment inside the enclosure against ingress of solid foreign objects (falling dirt); to provide a degree of protection with respect to harmful effects on the equipment due to the ingress of water (rain, sleet, snow); that will be undamaged by the external formation of ice on the enclosure that provides an increased level of protection against corrosion.

3) Type 4: Enclosures constructed for either indoor or outdoor use to provide a degree of protection to personnel against access to hazardous parts; to provide a degree of protection of the equipment inside the enclosure against ingress of solid foreign objects (falling dirt and windblown dust); to provide a degree of protection with respect to harmful effects on the equipment due to the ingress of water (rain, sleet, snow, splashing water, and hose directed water); and that will be undamaged by the external formation of ice on the enclosure.

4) Type 4X: Enclosures constructed for either indoor or outdoor use to provide a degree of protection to personnel against access to hazardous parts; to provide a degree of protection of the equipment inside the enclosure against ingress of solid foreign objects (falling dirt and windblown dust); to provide a degree of protection with respect to harmful effects on the equipment due to the ingress of water (rain, sleet, snow, splashing water, and hose directed water); that provides an increased level of protection against corrosion; and that will be undamaged by the external formation of ice on the enclosure..

5) Type 12: Enclosures constructed (without knockouts) for indoor use to provide a degree of protection to personnel against access to hazardous parts; to provide a degree of protection of the equipment inside the enclosure against ingress of solid foreign objects (falling dirt and circulating dust, lint, fibers, and flyings); to provide a degree of protection with respect to harmful effects on the equipment due to the ingress of water (dripping and light splashing) and to provide a degree of protection against light splashing and seepage of oil and non-corrosive coolants.

2.2.3 When controllers are placed into environments that are unusual service conditions such as direct sunlight, freezing, vandalism, infestation, etc., additional considerations should be given (see also NFPA 20 5.12). Consult controller manufacturers for recommendations.

2.2.4 Top entry conduit fittings into the fire pump controller should be as a minimum watertight. Conduit fittings on other sides of the controller should be suitable for the environment and enclosure type.

2.2.5 NFPA 20 10.3.3.1 allows the fire pump controller enclosure to be provided with an Ingress Protection (IP) rating of IP31 as a minimum. NEMA 250 correlates the ingress protection level for IP 31 rating to Types 4, 4X and 12 against the ingress of solid foreign objects, and Types 2, 3R, 3RX, 4, 4X, and 12 against the ingress of water. NFPA 20 provides an additional requirement for protection against the insertion of a rod having a diameter of 2.5mm. NEMA Types to Types 4, 4X and 12 meet this requirement.

Note: The NEMA 250 type rating system has additional requirements beyond ingress protection. These include corrosion resistance; gasket aging; and external icing resistance, and many more. So while a NEMA Type rating can meet an IP rating requirement, an IP rating can only meet a portion of a NEMA Type rating requirement.

**Table 1 -1
Comparison of Specific Applications of Enclosures for Indoor Nonhazardous
(Non-Classified) Locations**

Provides a Degree of Protection against the Following Conditions	Type of Enclosure									
	1 *	2 *	4	4X	5	6	6P	12	12K	13
Access to hazardous parts	X	X	X	X	X	X	X	X	X	X
Ingress of solid foreign objects (falling dirt)	X	X	X	X	X	X	X	X	X	X
Ingress of water (dripping and light splashing)	...	X	X	X	X	X	X	X	X	X
Ingress of solid foreign objects (circulating dust, lint, fibers, and flyings **)	X	X	...	X	X	X	X	X
Ingress of solid foreign objects (Settling airborne dust, lint, fibers, and flyings **)	X	X	X	X	X	X	X	X
Ingress of water (hose down and splashing water)	X	X	...	X	X
Oil and coolant seepage	X	X	X
Oil or coolant spraying and splashing	X
Corrosive agents	X	X
Ingress of water (occasional temporary submersion)	X	X
Ingress of water (occasional prolonged submersion)	X

**Table 1-2
Comparison of Specific Applications of Enclosures for Indoor & Outdoor Nonhazardous
(Non-Classified) Locations**

Provides a Degree of Protection Against the Following Conditions	Type of Enclosure									
	3	3X	3R*	3RX*	3S	3SX	4	4X	6	6P
Access to hazardous parts	X	X	X	X	X	X	X	X	X	X
Ingress of solid foreign objects (falling dirt)	X	X	X	X	X	X	X	X	X	X
Ingress of water (dripping and light splashing)	X	X	X	X	X	X	X	X	X	X
Ingress of water **(rain, snow, and sleet **)	X	X	X	X	X	X	X	X	X	X
Sleet ***	X	X
Ingress of solid foreign objects (windblown dust, lint, fibers, and flyings)	X	X	X	X	X	X	X	X
Ingress of water (hose down and splashing water)	X	X	X	X
Corrosive agents	...	X	...	X	...	X	...	X	...	X
Ingress of water (occasional temporary submersion)	X	X
Ingress of water (occasional prolonged submersion)	X

* These enclosures may be ventilated

** External operating mechanisms are not required to be operable when the enclosure is ice covered

*** External operating mechanisms are operable when the enclosure is ice covered (see **Error! Reference source not found.**)

**Table 1 -1
Comparison of Specific Applications of Enclosures for Indoor Nonhazardous
(Non-Classified) Locations**

Provides a Degree of Protection against the Following Conditions	Type of Enclosure									
	1 *	2 *	4	4X	5	6	6P	12	12K	13
Access to hazardous parts	X	X	X	X	X	X	X	X	X	X
Ingress of solid foreign objects (falling dirt)	X	X	X	X	X	X	X	X	X	X
Ingress of water (Dripping and light splashing)	...	X	X	X	X	X	X	X	X	X
Ingress of solid foreign objects (Circulating dust, lint, fibers, and flyings **)	X	X	...	X	X	X	X	X
Ingress of solid foreign objects (Settling airborne dust, lint, fibers, and flyings **)	X	X	X	X	X	X	X	X
Ingress of water (Hosedown and splashing water)	X	X	...	X	X
Oil and coolant seepage	X	X	X
Oil or coolant spraying and splashing	X
Corrosive agents	X	X
Ingress of water (Occasional temporary submersion)	X	X
Ingress of water (Occasional prolonged submersion)	X

2.3 TRANSFORMER SIZING

2.3.1 Where a transformer supplies an electric motor driven fire pump, it must be rated at a minimum of 125 percent of the sum of the fire pump motor(s) full-load current(s), and pressure maintenance pump(s)

motor loads, and 100 percent of the associated fire pump accessory equipment current supplied by the transformer (see NFPA 70 695.5(A)).

2.3.2 Regulation of the transformer should be adequate to meet the 5 percent motor running and 15 percent motor starting voltage drop limitations of NFPA 20 9.4 or NFPA 70 695.7.

2.3.3 Similar considerations should be given to transformers serving the fire pump and other system loads (see NFPA 70 695.5(C)).

Example: Calculate the minimum transformer size for a transformer dedicated to a 300 Hp, 460 volt fire pump motor. Assuming the transformer impedance is 5.75 percent, calculate the voltage drop during motor running and motor starting. Verify that these voltage drops do not exceed 5 percent during running or 15 percent during starting (NFPA 70 695.7 or NFPA 20 9.4).

a) Transformer minimum size (kVA)
$$= \frac{V_{L-L} \times MFLA \times 1.25 \times \sqrt{3}}{1000}$$

The next available size is
$$= 460 \times 361 \times 1.25 \times 1.732$$

$$= 360 \text{ kVA}$$

$$= 500 \text{ kVA}$$

b) Percent voltage drop during motor running
$$= \frac{Z \times MFLA \times 1.15 \times V_{L-L} \times \sqrt{3}}{\text{Transformer size (kVA)} \times 1000}$$

$$= \frac{5.75 \times 361 \times 1.15 \times 460 \times 1.732}{500 \times 1000}$$

= 3.8 percent

$$\begin{aligned} \text{c) Percent voltage drop during motor starting} &= \frac{Z \times \text{MFLA} \times 6 \times V_{L-L} \times \sqrt{3}}{\text{Transformer size (kVA)} \times 1000} \\ &= \frac{5.75 \times 361 \times 6 \times 460 \times 1.732}{500 \times 1000} \\ &= 19.8 \text{ percent} \end{aligned}$$

- d) Since the voltage drop during motor starting exceeds the NFPA limits, a larger transformer could be selected or a reduced voltage fire pump controller could be used.
- e) Using across-the-line starting and a 750 kVA transformer for the above example the percent voltage drop during motor running equals 2.4 percent and the percent voltage drop during motor starting equals 12.7 percent.
- f) Using the same 500 kVA transformer for the above example and a reduced voltage autotransformer type controller set at the 65 percent tap, the percent voltage drop during motor running remains equal to 3.8 percent, and the percent voltage drop during motor starting changes to 8.3 percent.

Notes 1: While the voltage drop of the transformer does not exceed the NFPA limits, care must be taken to ensure that the total voltage drop from the source, the transformer, and the power wiring added together does not exceed 5 percent during motor running or 15 percent during motor starting as required by NFPA 70 695.7 or NFPA 20 9.4.

Notes 2: Using the transformer impedance multiplied by the ratio of the motor current and the transformer full-load current provides a simplified estimate of the voltage drop.


2.4 TRANSFER SWITCH CONSIDERATIONS

2.4.1 Automatic transfer switches for fire pump control are applied per NFPA 70 695.3(B) and NFPA 20 10.8, Figure A.10.8.

2.4.2 When an Arrangement II as shown in Figure 1 is used, special attention should be given to the following issues.

- a) The combination fire pump controller/transfer switch must be listed for use with two utilities since the alternate side can be connected to the second utility.
- b) The upstream transfer switch should comply with NFPA 20 10.8.2.2 and 10.8.3.
- c) Upstream overcurrent protection must be sized to carry the locked-rotor current indefinitely in accordance with NFPA 70 695.4(B)(1). The transfer switch short circuit rating should be coordinated with the overcurrent protection device.

Note: In the event of a distressed pump causing locked-rotor currents that would exceed time limits permitted in NFPA 20 10.4.4, the locked-rotor protective device in the **controller** must be the only device to trip. This device can be readily reset since the controller is located within sight of the fire pump motor. Upstream overcurrent protective devices may be located in or beyond fire zones and must carry the locked-rotor current indefinitely in accordance with NFPA 70 695.4(B)(1).

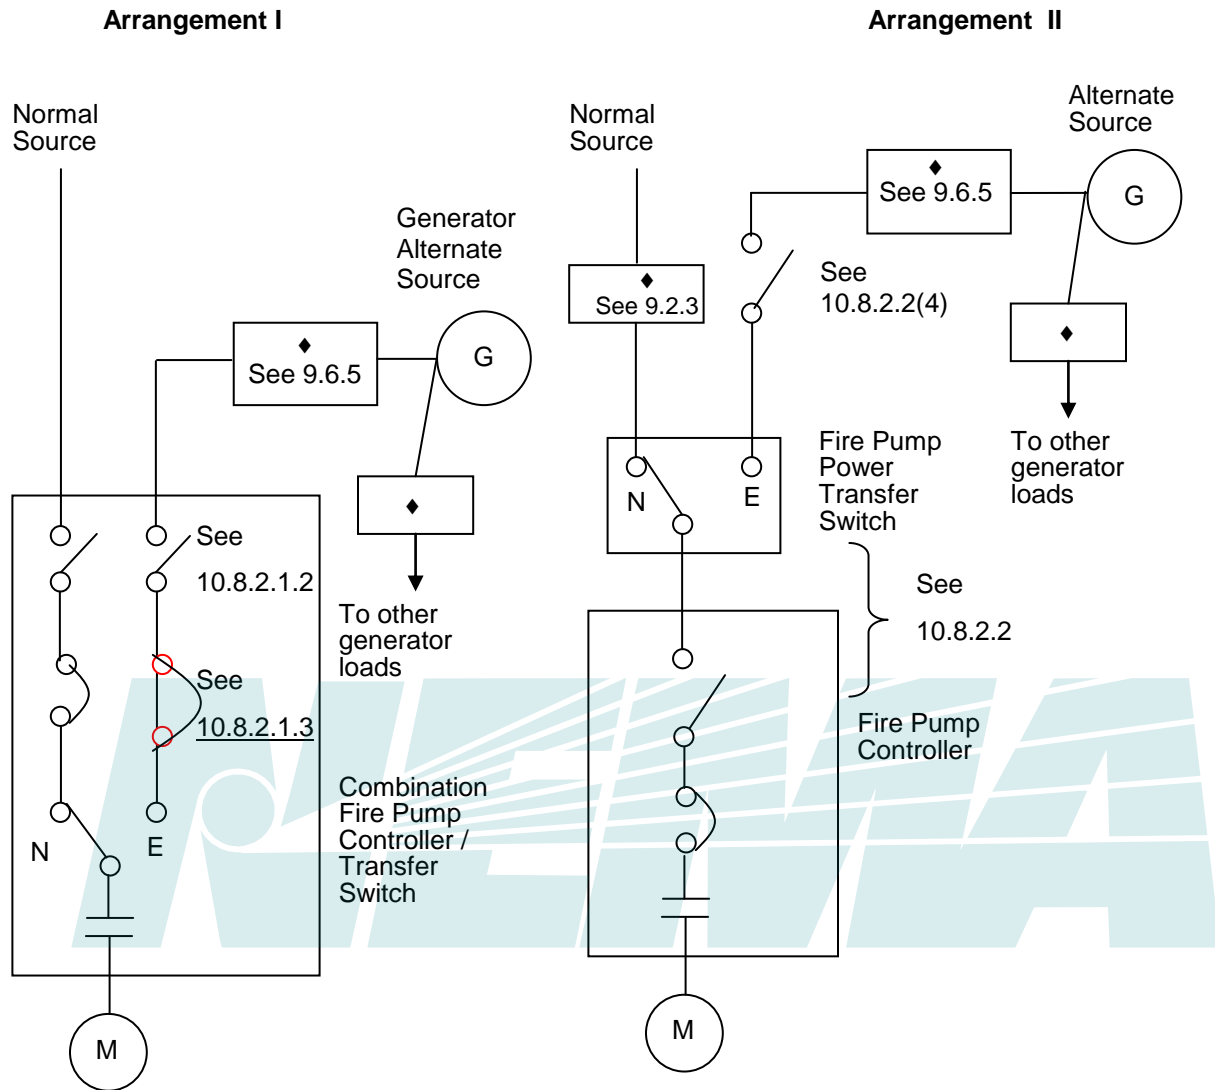


◆ Disconnecting means and overcurrent protective device(s) – circuit breakers or fusible switches may be used.

NOTE 1—All references are to NFPA 20-2010.

Figure 1
TYPICAL FIRE PUMP CONTROLLER AND TRANSFER SWITCH ARRANGEMENTS I AND II
NORMAL SOURCE FROM A UTILITY AND ALTERNATE SOURCE FROM AN ON-SITE GENERATOR

Arrangement I-Dual Utility

**Arrangement I –
Two or more Alternate Sources**

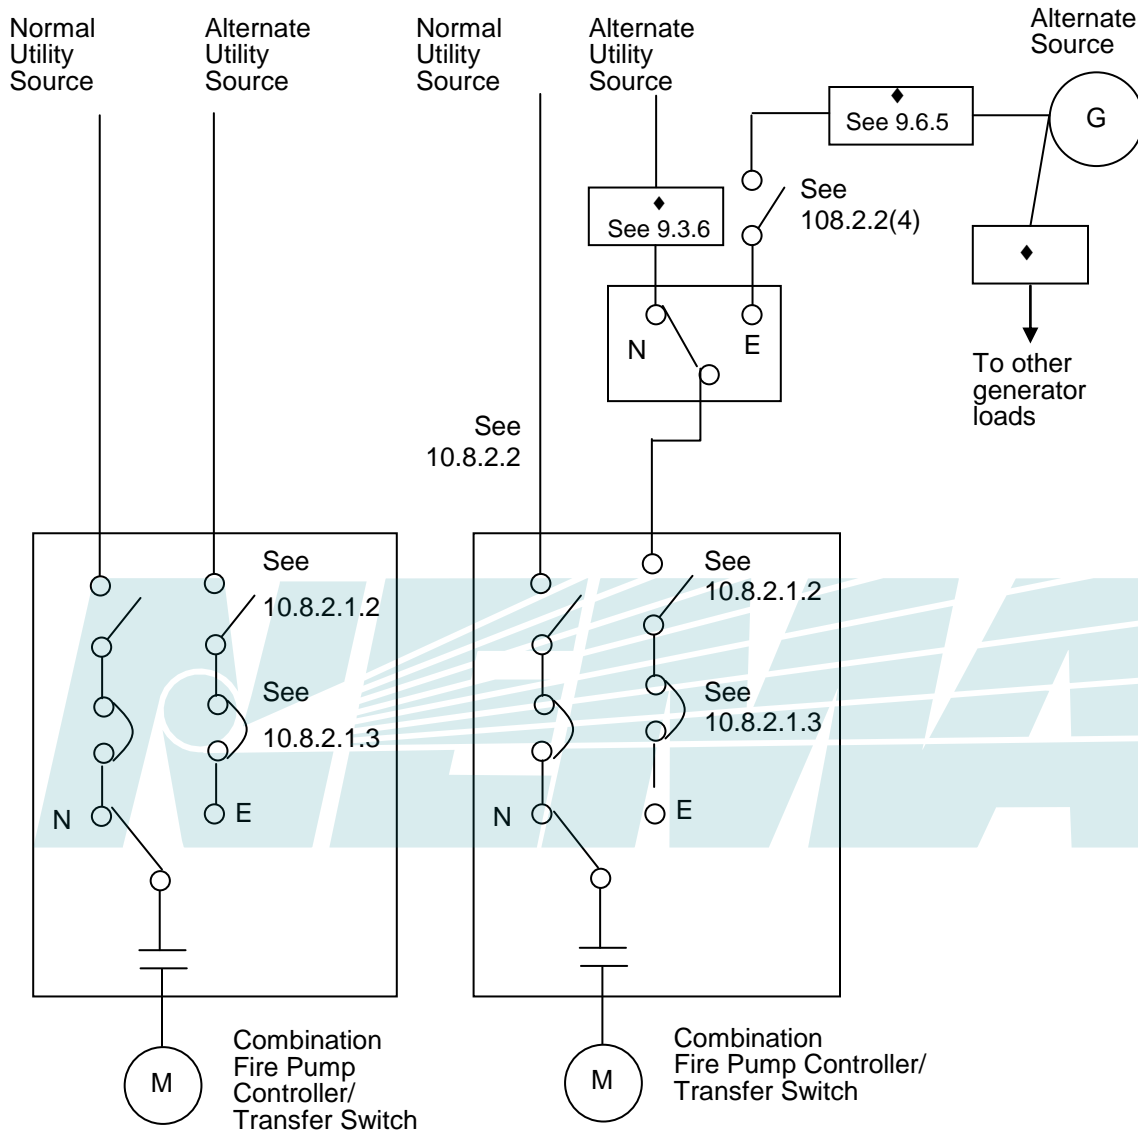

◆ Disconnecting means and overcurrent protective device(s) – circuit breakers or fusible switches may be used.

Note 1: Examples where the combination fire pump controller/transfer switch must be suitable for use with two (2) utilities. See NFPA 20 10.8.2.1.3.

Note 2: All references are to NFPA 20-2010.

Figure 2
OTHER FIRE PUMP CONTROLLER AND TRANSFER SWITCH CONFIGURATIONS FOR
ARRANGEMENT I - DUAL UTILITY OR TWO OR MORE ALTERNATE SOURCES

2.5 CONSIDERATIONS FOR SPECIFYING SHORT CIRCUIT RATING (RMS SYM)

2.5.1 This is a simplified procedure with examples for specifying the fire pump controller short circuit rating. All calculations assume unlimited short-circuit current at the transformer primary.

1) "Method One" is the simplest, requiring limited calculations. Selection of the fire pump controller short circuit rating is made from Table 2. This method is applicable for systems with power transformers ranging from 500 kVA through 2500 kVA with standard impedance values of 2.0 percent and higher.

2) "Method Two" covers all other systems which cannot be established from Table 3. This is a simplified procedure for determining the available short-circuit current with a reasonable degree of accuracy.

3) Information required:

- a) Transformer kVA and secondary voltage
- b) Transformer percent impedance
- c) Length of circuit and size of power conductor between the transformer and controller line terminals.
- d) Motor full-load current (required for Method Two only)

Note: The above information can be obtained from nameplate data and the local power utility.

2.5.2 Method One: Fire pump controller short circuit rating selection from Table 2.

- a) Select the appropriate transformer kVA rating and power cable column.
- b) Note the minimum cable length for the appropriate secondary voltage that must be installed between the transformer and fire pump controller.
- c) The required fire pump controller short circuit rating is then established from the fire pump controller short-circuit current rating column.

Example: A 200 HP, 460 volt, 60 Hz controller is located 100 feet from a 2000 kVA supply transformer (transformer impedance is 5.75 percent). The power conductor consists of one 350 kcmil cable per phase in a steel conduit.

- d) Refer to Table 2 for a 2000 kVA transformer with a 480 volt secondary and a 350 kcmil power cable and note the minimum cable length; in this case it is 42.3 feet. Based on this, a fire pump controller with a 30,000 amp short circuit current rating can be used.

Conclusion: Since the installation used 100 feet of cable, which exceeds the 42.3 feet value found in Table 2, a fire pump controller with a 30,000 ampere short-circuit current rating is suitable for use on this circuit.

Table 2
FIRE PUMP CONTROLLER SHORT CIRCUIT CURRENT RATING

Transformer KVA % Imped.		Secondary Volts	Transformer Sec. S-C Current	Controller S-C Current Rating	Minimum Length of Cable Between Transformer and Controller in feet								
					Wire Size								
					500 kcmil	350 kcmil	300 kcmil	250 kcmil	4/0 AWG	3/0 AWG	1/0 AWG	1 AWG	2 AWG
500	2.00%	208	69,395	42000	20.4	18.3	16.7	15.2	13.9	11.7	8.1	6.6	5.4
		240	60,142	42000	18.0	16.1	14.7	13.4	12.2	10.4	7.2	5.9	4.7
		380	37,985	30000	27.8	24.9	22.8	20.8	18.9	16.0	11.1	9.0	7.3
		480	30,071	30000	0.4	0.4	0.3	0.3	0.3	0.2	0.2	0.1	0.1
		600	24,057	22000	24.4	21.8	19.9	18.2	16.6	14.0	9.7	7.9	6.4
750	5.75%	208	36,206	42000	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
		240	31,379	42000	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
		380	19,818	30000	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
		480	15,689	30000	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
		600	12,551	22000	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
1000	5.75%	208	48,275	42000	6.7	6.0	5.5	5.0	4.6	3.9	2.7	2.2	1.8
		240	41,838	42000	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
		380	26,424	30000	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
		480	20,919	30000	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
		600	16,735	22000	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
1250	5.75%	208	60,344	42000	15.7	14.1	12.9	11.7	10.7	9.0	6.2	5.1	4.1
		240	52,298	42000	11.8	10.5	9.6	8.8	8.0	6.8	4.7	3.8	3.1
		380	33,030	30000	12.1	10.9	9.9	9.1	8.3	7.0	4.8	3.9	3.2
		480	26,149	30000	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
		600	20,919	22000	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
1500	5.75%	208	72,412	42000	21.7	19.5	17.8	16.2	14.8	12.5	8.6	7.1	5.7
		240	62,757	42000	19.8	17.7	16.2	14.7	13.4	11.3	7.8	6.4	5.2
		380	39,636	30000	32.2	28.8	26.3	24.0	21.9	18.5	12.8	10.5	8.5
		480	31,379	30000	7.3	6.6	6.0	5.5	5.0	4.2	2.9	2.4	1.9
		600	25,103	22000	35.2	31.5	28.8	26.3	23.9	20.2	14.0	11.4	9.3

Table 2 continued on next page

Table 2 (continued)
FIRE PUMP CONTROLLER SHORT CIRCUIT CURRENT RATING

Transformer KVA % Imped.		Secondary Volts	Transformer Sec. S-C Current	Controller S-C Current Rating	Minimum Length of Cable Between Transformer and Controller in feet								
					Wire Size								
					500 kcmil	350 kcmil	300 kcmil	250 kcmil	4/0 AWG	3/0 AWG	1/0 AWG	1 AWG	2 AWG
2000	5.75%	208	96,550	42000	29.2	26.2	23.9	21.8	19.9	16.8	11.6	9.5	7.7
		240	83,676	42000	29.7	26.6	24.3	22.2	20.2	17.1	11.8	9.7	7.8
		380	52,848	30000	57.2	51.2	46.8	42.7	38.9	32.9	22.7	18.6	15.1
		480	41,838	30000	47.3	42.3	38.7	35.3	32.2	27.2	18.8	15.4	12.4
		600	33,471	22000	97.7	87.4	79.9	72.9	66.4	56.1	38.8	31.7	25.7
2500	5.75%	208	120,687	42000	33.7	30.2	27.6	25.2	22.9	19.4	13.4	11.0	8.9
		240	104,596	42000	35.7	32.0	29.2	26.7	24.3	20.5	14.2	11.6	9.4
		380	66,060	30000	72.3	64.7	59.1	53.9	49.1	41.5	28.7	23.5	19.0
		480	52,298	30000	71.3	63.8	58.3	53.2	48.4	41.0	28.3	23.2	18.7
		600	41,838	22000	135.1	121.0	110.5	100.8	91.8	77.7	53.7	43.9	35.5

Note 1: Calculations based on a simplified method of determining short circuit currents

Note 2: Values in the table above are approximate

Note 3: Where the value in the table is zero (0), the short circuit rating of the controller is above the available short circuit current, and therefore, does not require any additional cable to reduce the available short circuit current below the controller rating

2.5.3 Method Two: Use this method only when the transformer secondary voltage and available secondary short-circuit current is known.

Example: A 200 HP, 460 volt, 60 Hz controller is located 150 feet from a transformer having a 200,000 ampere secondary short circuit current availability. The motor has a full-load current rating of 240 amperes, thus requiring conductors capable of carrying 300 amperes (240 x 1.25 = 300). Table 310.16 of the NEC specifies 350kcmil cable (refer to Table 3). Under the 350 kcmil cable column the minimum cable length between the transformer and the controller is 127.2 feet. Since the 150 foot cable length exceeds the allowable length of 127.2 feet, a controller having a 30,000 ampere short-circuit rating is suitable.

The calculations and data in Table 3 assume that the fire pump controller is connected in the preferred manner to a dedicated transformer supplied by a utility service (for calculation purposes, power availability from a utility source is considered to be infinite). It therefore assumes there are no motor contributions to the available short circuit currents. Where connected motors contribute to the available short circuit current, a more detailed analysis should be made (see IEEE Std. 242).

Table 3
TRANSFORMER SECONDARY VOLTAGE AND AVAILABLE SECONDARY SHORT-CIRCUIT CURRENT

Transformer KVA				Minimum Length of Cable Between Transformer and Controller in feet									
				Wire Size									
				Secondary Volts	Transformer Sec. S-C Current	Controller S-C Current Rating	500 kcmil	350 kcmil	300 kcmil	250 kcmil	4/0 AWG	3/0 AWG	1/0 AWG
	208	200,000	42000	40.9	36.6	33.4	30.5	27.8	23.5	16.2	13.3	10.8	
	240	200,000	42000	47.2	42.2	38.6	35.2	32.1	27.1	18.7	15.3	12.4	
	380	200,000	30000	112.5	100.7	92.0	83.9	76.5	64.6	44.7	36.6	29.6	
	480	200,000	30000	142.1	127.2	116.2	106.0	96.6	81.7	56.5	46.2	37.4	
	600	200,000	22000	253.7	227.0	207.4	189.2	172.4	145.7	100.8	82.4	66.7	
	208	100,000	42000	30.0	26.9	24.5	22.4	20.4	17.2	11.9	9.8	7.9	
	240	100,000	42000	34.6	31.0	28.3	25.8	23.5	19.9	13.8	11.3	9.1	
	380	100,000	30000	92.7	82.9	75.8	69.1	63.0	53.2	36.8	30.1	24.4	
	480	100,000	30000	117.0	104.8	95.7	87.3	79.5	67.3	46.5	38.0	30.8	
	600	100,000	22000	222.3	199.0	181.8	165.8	151.1	127.7	88.3	72.2	58.5	

Note 1: Calculations based on a simplified method of determining short circuit currents

Note 2: Values in the table above are approximate

2.6 REDUCED VOLTAGE STARTING METHODS

Table 4
REDUCED VOLTAGE STARTING METHODS

Starting Method	Controller Operation	Starting Current % of Full Load Amps		Starting Torque	Open Or Closed Transition
Across the Line	Initially connects motor directly to power lines	600%		100%	None
Primary Reactor	Inserts reactance in series with motor during starting	300% 390%		25% 42%	Closed
Primary Resistance	Inserts resistance units in series with motor during starting	300% 390%		25% 42%	Closed
Autotransformer	Uses auto-transformer to reduce voltage to motor	<u>Tap</u> 50% 65% 80%	<u>Current</u> 175% 277% 409% *includes magnetization current	25% 42% 64%	Closed
Wye-Delta	Starts motor with windings wye connected, then controller reconnects them in delta	200%		33%	Open or Closed
Solid State Soft Start/Stop	Uses special soft start module to control current and voltage to motor	Varies (300-400%)		Varies (12 -100%)	Closed
Part Winding	Starts motor with only part of winding connected, then adds remainder for running	360%-420%		50 - 60% Minimum pull-up torque 35% of full load.	Closed
Variable speed	Uses special variable frequency section to control the motor voltage and frequency	Selectable and typically set for 125%		100%	Closed

Variable Speed

Note 1: Consideration should be given to the method of starting and the power source. Consult the controller manufacturer for additional information.

Note 2: The voltage drop limitation requirements of NFPA 70 695.7 and NFPA 20 9.4 are not applicable when the manual emergency handle is used on reduced voltage controllers. Under that condition the power supply need only be capable of starting and running the motor as demonstrated during acceptance testing of the fire pump system.

Note 3: Consideration should be given to the effects of transition currents of open transition controllers on circuit breakers, generators, couplings, pump shafts and other components of the fire pump system.

2.7 LIMITED SERVICE CONTROLLER LIMITATIONS

2.7.1 Limited service controllers (NFPA 20 10.7) are restricted application controllers for smaller fire pumps driven by electric motors. These controllers are restricted to those installations where their use is expressly acceptable to the Authority Having Jurisdiction (AHJ) (see NFPA 20 3.2.2 (and A.3.2.2), "Approved" (and A-1-8, "Approved")).

2.7.2 Express restrictions, beyond acceptability to the AHJ, are placed on Limited Service Controllers and the motors they control by NFPA 20 10.7 (and also A10.7). The controller must be automatic (non-automatic controllers are not permitted) for across-the-line starting (reduced voltage starting is not permitted) and the controller must be specifically marked "Limited Service Controller." The motor must be squirrel-cage rated 30 horsepower or less and 600 Volts or less.

2.7.3 NFPA 20 10.7.2.1 permits the locked-rotor protection in a limited service controller to be accomplished by a standard thermal-magnetic circuit breaker in place of the instantaneous trip only circuit breaker and locked-rotor protector (see NFPA 20 10.4.3.3.1 and 10.4.4) required in an electric fire pump controller. Limited service controllers employing this exception should not be installed where the ambient temperature is not stable. **It may be impossible to reset the circuit breaker immediately after tripping, delaying the restoration of fire protection.** Depending on the tripping characteristics of the circuit breaker it is possible to burn out the motor on the first automatic start under locked-rotor conditions, thus leaving no chance for manual recovery.

2.7.4 NFPA 20 10.7.2.4 permits the omission of the isolating switch (see NFPA 20 10.4.2) in a limited service controller. For installations employing limited service controllers manufactured under this exception, it may be necessary to contact the utility providing electric power to disconnect that power when maintenance on or replacement of power components such as the circuit breaker and voltage surge arrester (see NFPA 20 10.4.1) in the controller is required.

2.7.5 Since sizing of the breaker is different, the tripping time can significantly exceed the 8 to 20 seconds locked rotor current (LRC) trip time of a full-service fire pump controller depending on hot or cold starts. This can damage the motor to the point where the emergency run handle or lever is ineffective..

2.8 LISTED FIRE PUMP MOTOR APPLICATIONS

2.8.1 NFPA 20 9.5 requires motors to be NEMA Design B, code letters F or G for motors 15 hp and over, code letters F, G, or H for 10 or 15 hp, and Code letters F, G, H or J for motors 5 hp and less (see NFPA 70 430.7(B)), and specifically Listed and Marked for Fire Pump Service. In some exceptions, standard squirrel-cage motors meeting these requirements are suitable for across-the line starting and autotransformer, primary reactor, primary resistor, and solid-state soft-start reduced voltage starting. Special motors also meeting these requirements are suitable for Part-Winding and Wye-Delta reduced voltage starting. Motors for part-winding starting must be specified to the motor manufacturer as being of the "50%-50%" starting type.

2.8.2 Because full load current and locked rotor current for the same rated motor can vary considerably among various manufacturers, it is helpful to provide to the fire pump controller manufacturer the code letter, full-load current and locked-rotor current of the selected motor to assure accurate locked-rotor motor protection. If this information is not provided at the time of order entry, it should be expected that the locked rotor protection will be provided in accordance with the specified motor horsepower and voltage and NFPA 70 Table 430.7(B), code "G" for motor locked rotor current and Table 430.247, 430.248, 430.249, or 430.250 (as appropriate), for motor full load current.

2.8.3 Motors used at altitudes above 3300 feet (1000 meters) shall be operated or derated according to NEMA Standards Publication MG 1, *Motors and Generators*, Part 14.

2.8.4 Direct-current, high-voltage (over 600 volts), large-horsepower (over 500 horsepower), single-phase, universal-type, or wound-rotor motors shall be permitted to be used where approved.

2.8.5 Motors for fire protection are covered by UL Standard 1004-5 "Fire Pump Motors", but the scope of the standard restricts motors to Design B polyphase motors rated 500 hp or less and 600 V or less. Where motors of types outside this scope are used, motors shall comply with NEMA MG1 "Motors and Generators" and shall have the following characteristics:

- a) Locked rotor currents in accordance with Table 9.5.1.1 of NFPA 20
- b) Rated for continuous duty
- c) Service factor not larger than 1.15
- d) Marked in accordance with NEMA MG1

- e) Sufficient terminal box size
- f) Torque suitable for the application
- g) Shall be provided with a connection diagram per NEMA MG1

2.9 2.9 PRESSURE RECORDERS

2.9.1 A listed pressure recording device is required to sense and record the pressure in each fire pump controller pressure-sensing line at the input to the controller (see NFPA 20 10.5.2.1.7.2).

2.9.2 A pressure recording device in a listed controller meets the requirements of 2.9.1 and the requirements of NFPA 20 10.5.2.1.7.2 and 10.5.2.1.7.3.

2.10 STAND-BY GENERATOR SIZING FOR FIRE PUMPS

2.10.1 The sizing of stand-by generators for driving fire pump motors needs to consider a number of special requirements unique to fire pump installations. These requirements are contained in NEC Article 695 and NFPA 20 Chapters 9 and 10.

2.10.2 Exact calculations suitable for specifications and purchasing decisions require calculations that take all factors affecting burden on the generator into account. For precise sizing calculations, consult the fire pump controller manufacturer and the gen-set manufacturer/supplier for additional information on reduced voltage starting methods. To properly size the gen-set for a fire pump application, it is necessary to know the starting kVA, the starting kW, the running kVA, the running kW, and the allowable voltage dip. For across-the-line motor starting applications, these numbers can be approximated by the following calculations:

Starting kVA = Locked Rotor Code value x the Rated Motor HP

Note: See NFPA 70 Table 430.7(B) for locked rotor codes and values.

Starting kW = Starting kVA x Starting Power Factor

Note: The starting power factor of a typical motor is 0.4.

Running kVA = Full Load Motor Current x Motor Service Factor x Rated Motor Voltage x 1.732 ÷ 1000

Note: The motor service factor is typically 1.15.

Running kW = Running kVA x Running Power Factor

Note: The running power factor is typically 0.8.

2.10.3 Voltage dip cannot exceed 15 percent as defined by NFPA 20 paragraph 9.4 and NFPA 70 paragraph 695.7. However, the exceptions to these paragraphs eliminate the voltage dip limitation if the emergency run mechanical starting control is used.

2.10.4 If reduced voltage starting is used, the locked rotor motor current can be reduced according to the type of starting (see Table 4). However, consideration should be given to the following:

- a) The effects of open transition starting on gen-sets.
- b) The available starting torque required to accelerate the fire pump under the specified load, to full speed before the transition to full voltage running takes place.
- c) The combined starting power factor when primary resistor starting is used.

2.11 MEDIUM VOLTAGE FIRE PUMP CONTROLLERS (7.2 kV MAX)

2.11.1 NFPA 20, paragraph 10.6 addresses fire pump controllers rated in excess of 600V. It permits certain deviations from the requirements of electric fire pump controllers rated 600V maximum. The significant deviations are:

- a) Mandates externally readable ammeter and voltmeter(s)
- b) Permits use of current-limiting fuses in place of circuit breaker
- c) Permits drop-out of contactor instead of circuit breaker upon tripping of locked rotor protector
- d) Requires grounded control circuit
- e) Additional safety interlocks for operator protection
- f) Requires high voltage primary fuses for the low voltage control circuit

2.11.2 Concerns arising from these significant deviations are:

- a) There is essentially no locked rotor protection when emergency-run mechanical control at the controller is used to run the pump,
- b) Power fuses sized to hold 600 percent maximum full-load current for 100 seconds (minimum),
- c) There is no instantaneous “re-setting” capability when a power fuse blows,

Note: NFPA 20 requires a spare set of fuses of the correct rating be kept readily available inside the controller.

- d) The magnetic operation of the contactor requires a functional control circuit (coil not at line voltage).

2.11.3 NFPA 70 paragraph 240.12 has special importance in fire pump controls. NFPA 70 240.12 addresses electrical system coordination, which in fire pump controls means that pump room electrical faults should be cleared in the pump room. This is important since the location of an upstream protective device may be beyond reach during a fire.

2.11.4 Manufacturers of medium voltage fire pump controllers size “R” rated fuses to meet the following criteria:

- a) R-rated fuses must have the correct voltage rating
- b) The fuses will safely interrupt all currents between their minimum and maximum interrupting rating
- c) The fuses must hold locked-rotor current for 100 seconds minimum
- d) The fuses will open in a range of 15 to 35 seconds at a value of 100 times the “R” number

2.11.5 To obtain proper selective coordination a study must be performed. Two methods are used:

- a) Overlays of time-current curves, which use manufacturers’ published data
- b) Computer programs that permit the designer to select time current curves published by the manufacturers

2.11.6 It is important to remember that the R-rated fuse selection in fire pump controllers is different than what is normal in industrial controllers, which include motor overload protection, and that the goal of selective coordination is to have the faulted circuit isolated by having the overcurrent protective device closest to the overcurrent condition trip or open.

2.12 VARIABLE SPEED PRESSURE LIMITING ELECTRIC FIRE PUMP CONTROLLERS

2.12.1 General. NFPA 20, paragraph 10.10 through 10.10.12 addresses the requirements for electric fire pump controllers with variable frequency drives to vary the speed of the motor to adjust the output pressure of the fire pump to a predetermined value. This predetermined value is called the "Set Pressure."

a) By controlling the output pressure of the fire pump to the Set Pressure, the variable speed pressure limiting electric fire pump controller (VSPLEFPC) can be used to eliminate pressure reducing valves in applications where the suction pressure varies considerably.

2.12.2 Controller Elements. The VSPLEFPC incorporates many items not always used in commercial or industrial Variable Speed Drive (VSD) applications but is required for these controllers. Figure 3 shows these items and references the NFPA paragraph number accordingly.

a) Circuit Protection, as shown in Figure 3, is sized to prevent the fire pump controller circuit breaker from tripping under all overload conditions in the VSD path. This protection will not necessarily protect the load side components from damage.

b) Line Isolation Contactor (as shown in Figure 3), is provided to keep the VSD "off-line" until it is needed.

1) Keeping the VSD off-line increases the life of the VSD, it's capacitors, and reduces the likelihood of damage due to line surges.

2) Line Reactance (as show in Figure 3), is required to be a minimum of 5%. 5% Line reactance helps in the following ways:

a) Reduces line harmonics currents and frequencies to less than 35% THD.

b) Reduces the RMS line current to approximately 106% of the motor FLA.

c) Suppresses transients from the line that could damage the VSD.

3) The VSD (shown in Figure 3), must be designed to power-up and begin to operate in 5 seconds.

4) Load Isolation Contactor, as shown in Figure 3, must isolate the VSD so the bypass contactor can be used without back feeding the VSD.

2.12.3 Motor issues:

a) The service factor of the motor can not be used when applying a general purpose motor that has a service factor onto an inverter drive, even if the motor is suitable for inverter duty.

b) The motor manufacture should be consulted to determine the limitations that are imposed on a general purpose motor when it is use in an inverter duty application.

2.12.3.1.1 Typically, these limitations are:

a) The service factor cannot be used

b) The motor load must be a variable torque load

c) The turndown ratio should not be greater than 4:1

d) The cable length between the inverter and the motor should not exceed 100 feet

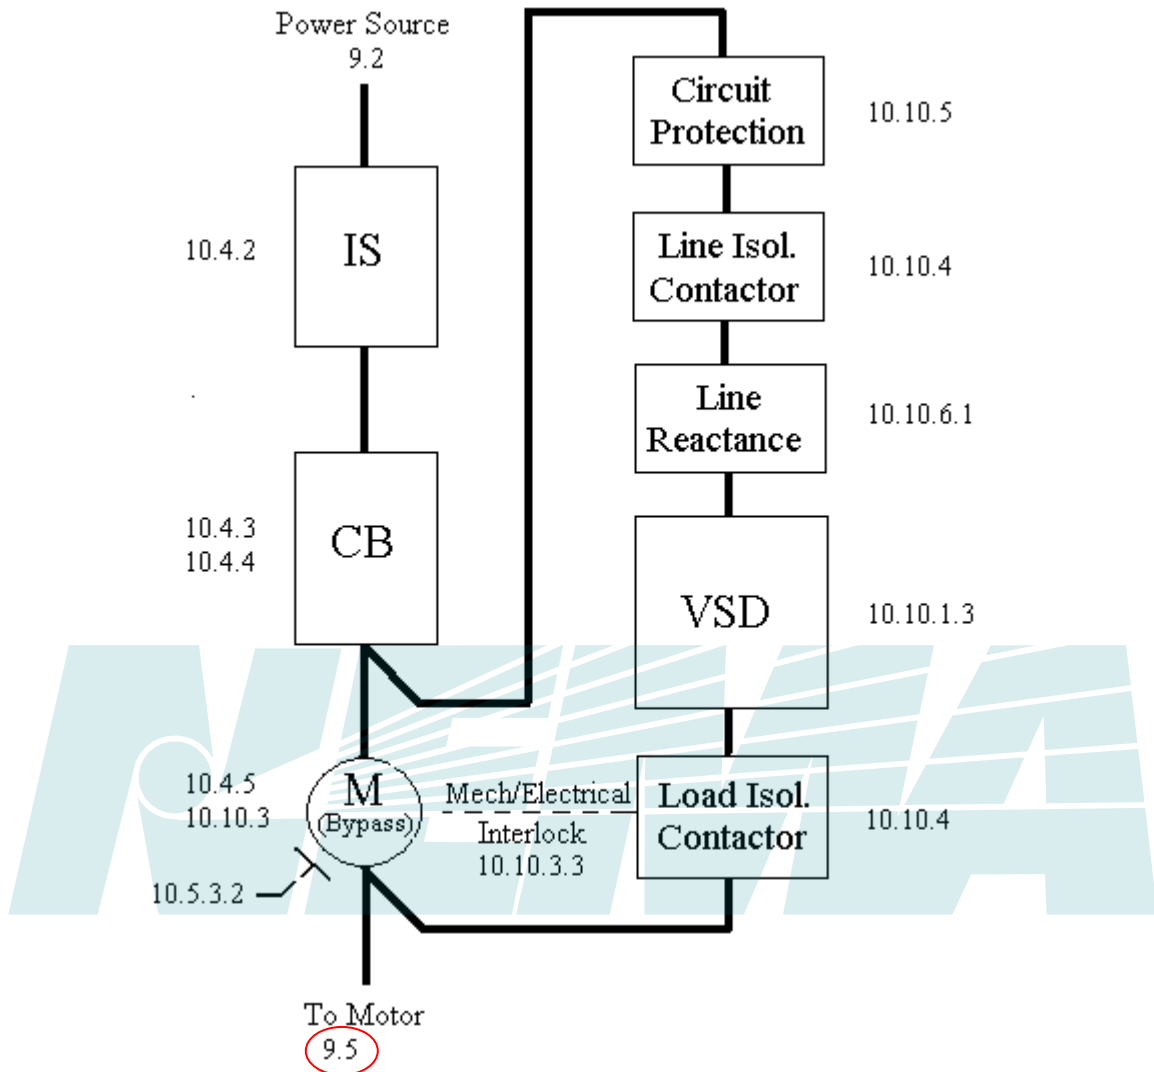


Figure 3
VARIABLE SPEED PRESSURE LIMITING ELECTRIC FIRE PUMP CONTROLLER

2.13 UPSTREAM OVERCURRENT PROTECTION IN FIRE PUMP CIRCUITS

- 2.13.1 NFPA 20 paragraph 9.2.3.4 requires that the upstream overcurrent protection be rated to hold the locked rotor currents of the fire pump and jockey pump motors as well as the full load current of associated accessory equipment.
- 2.13.2 This is approximately 600% of the fire pump FLA which is much larger than the typical 175%-300% maximum protection allowed for standard NEC motor circuits (see NEC section 430).
- 2.13.3 The larger sizing ensures that this upstream overcurrent protection will not trip under the following conditions:
- 1) Single phasing of the fire pump motor
 - 2) 600% FLA indefinitely
 - 3) Instantaneous currents caused by wye-delta, open transition, transition currents
 - 4) Instantaneous currents caused by a start, stop, and immediate restart

2.14 PHASE CONVERTERS

2.14.1 NFPA 9.1.7 and A9.1.7 states that Phase converters shall not be used to supply power to a fire pump.

2.14.2 Phase converters that take single-phase power and convert it to three-phase power for the use of fire pump motors are prohibited because of the imbalance in the voltage between the phases when there is no load on the equipment. If the power utility installs phase converters in its own power transmission lines, such phase converters are outside the scope of this standard and need to be evaluated by the authority having jurisdiction to determine the reliability of the electric supply.

3 INSTALLATION CONSIDERATIONS

3.1 PHASE SEQUENCE

- 3.1.1 Electric fire pump controllers are phase sequence sensitive and will cause an alarm to be issued if connected to a power source incorrectly (see NFPA 20, 10.4.7.2.3 and 10.4.8). If incorrect phase sequence is detected upon initial installation, the proper action at this juncture is to disconnect incoming power and correct for proper phase rotation. Proper motor rotation must be verified after proper controller phase sequence is established.
- 3.1.2 Motor rotation correction may be accomplished as follows:
- a) Three lead motors: Interchange any two motor leads on the load side terminals of the main contactor.
 - b) Six lead motors used with part-winding or wye-delta controllers: Interchange any two motor leads on the load side terminals of both the start and the run contactors. i.e., interchange phase 1 and phase 2 on the run contactor and the start contactor or phase 2 and phase 3 on each contactor.
- 3.1.3 On controllers having multiple power sources, the alternate source is also phase sensitive.

3.2 NORMAL STARTING WITH ON-SITE GENERATORS

3.2.1 Where on-site generator systems are used to supply power to fire pump motors, they shall be of sufficient capacity to allow normal starting and running of the fire pump motor(s) while supplying all other simultaneous loads (see NFPA 20 9.6.1). Automatic shedding of one or more optional standby loads is permissible (see NFPA 70 695.3(B)(1)).

3.2.2 Normal starting is determined by the type of motor starting provided in the fire pump controller. If across-the-line starting is provided, then the full locked rotor motor current should be used to calculate the motor starting voltage drop (see NFPA 20 9.4 and NFPA 70 695.7). If reduced voltage starting is provided, then the locked rotor motor current can be reduced by the appropriate amount shown in Table 4 of 2.6 of this document.

3.2.3 Use of the Emergency-Run Mechanical Control provides across-the-line starting even on reduced voltage controllers. Since it is an emergency control, it is not considered a means of normal starting. Furthermore, the exception to NFPA 20 9.4 and NFPA 70 695.7 states that the motor voltage drop requirements do not apply during Emergency-Run Mechanical starting.

3.3 INDUCED VOLTAGES ON CONTACTS FOR REMOTE SIGNALING

3.3.1 High impedance circuits, such as computer alarm systems that monitor “dry” or “voltage free” contacts can pick-up induced voltages on these contacts.

3.3.2 A simple method to determine if this is an induced voltage is to use an analog voltmeter to read across the contacts. If the voltage disappears, then the voltage is likely an induced voltage. This is beyond the normal service conditions of the equipment and is difficult to correct in the field. Contact the controller manufacturer for further advice.

3.3.3 Users intending to monitor alarm and status circuits with high impedance sensors, such as computers, must so advise the manufacturer before the fire pump controller is manufactured and shipped. The limits of induced potential in those circuits is a matter of agreement between user and manufacturer.

3.4 GROUNDED CIRCUIT CONDUCTOR (NEUTRAL OR NEUTRAL CONDUCTOR) CONSIDERATIONS

3.4.1 Since NFPA 20 subclause 10.3.4.6, prohibits the fire pump controller from being used as a junction box to supply other equipment, the electrical load in the fire pump controller will always be balanced. The controller is dedicated to the fire pump motor. Therefore, in the absence of prohibited unbalanced single-phase loads, the “neutral current” is essentially zero.

3.4.2 The NFPA 70 permits the grounded circuit conductor (neutral) to be grounded only in the service equipment. Fire pump controllers used as service equipment are equipped to accommodate, bond, and ground that grounded circuit conductor. It is recommended that the grounded circuit conductor (neutral) **NOT** be routed to fire pump controllers connected electrically downstream of a service disconnect as permitted by NFPA 70 695.4(B).

4 OTHER CONSIDERATIONS

4.1 LISTED AND APPROVED EQUIPMENT

Controllers that bear the mark of a nationally recognized testing laboratory have been evaluated to be in compliance with NFPA 20 when installed in accordance with NFPA 70 (see NFPA 70, 90.7). Each fire pump controller has been evaluated for each horsepower and voltage rating to the satisfaction of listing/approval agencies whose mark appear thereon. This evaluation includes a review of the component rating, conductor sizes and relay functions/logic to assure compliance with applicable Codes and Standards.

4.2 TESTING AND MAINTENANCE

The procedures as stated in NFPA 25, *Standard for the Inspection, Testing, and Maintenance of Water-Based Fire Protection Systems*, should be followed for proper maintenance and periodic testing.

§



< This page is intentionally left blank. >

